# APPENDIX DATA

ATTACHMENT H: WIPP WASTE CONTAINERS AND EMPLACEMENT

This page intentionally left blank

1		Table of Contents	
2	DATA-H-1.0 AUTH	ORIZED WASTE EMPLACEMENT CONTAINERS	1
3	DATA-H-1.1	Container Descriptions	1
4	DATA-H-1.2	Dunnage Containers	1
5		List of Figures	
6	Figure DATA-H-1.	55-Gallon Drum Components and Emplacement Configuration	2
7	Figure DATA-H-2.	85-Gallon Drum (Short) Components and Emplacement	
8	U U	Configuration.	3
9	Figure DATA-H-3.	85-Gallon Drum (Tall) Components and Emplacement	
10		Configuration.	4
11	Figure DATA-H-4.	100-Gallon Drum Components and Emplacement	
12	U U	Configuration.	5
13	Figure DATA-H-5.	Illustration of a Standard Waste Box.	
14	Figure DATA-H-6.	TDOP Components	7
15	Figure DATA-H-7.	RH-TRU Waste Canister Components.	8
16	Figure DATA-H-8.	CH-TRU Waste Emplacement Layout	9
17	Figure DATA-H-9.	CH-TRU Waste Emplacement.	
18	Figure DATA-H-10.	Planned RH-TRU Waste Emplacement.	11
19		List of Tables	
20	Table DATA-H-1.	55-Gallon Drum Specifications	2
21	Table DATA-H-2.	85-Gallon Drum (Short) Specifications	
22	Table DATA-H-3.	85-Gallon Drum (Tall) Specifications	4
23	Table DATA-H-4.	100-Gallon Drum Specifications	
24	Table DATA-H-5.	SWB Specifications	
25	Table DATA-H-6.	TDOP Specifications	
26	Table DATA-H-7.	RH-TRU Waste Canister Specifications	
27			

This page intentionally left blank

- 1 DATA-H-1.0 AUTHORIZED WASTE EMPLACEMENT CONTAINERS
- 2 DATA-H-1.1 Container Descriptions
- 3 The Compliance Certification Application (CCA) to the Environmental Protection Agency
- 4 *(EPA) identified the following containers as outer containment vessels for waste emplacement* 5 *in the repository:*
- 6 208-L (55-g) Drum
- 7 322-L (85-g) Drum (Short)
- 8 322-L (85-g) Drum (Tall)
- 9 379-L (100-g) Drum
- 10 Standard Waste Box (SWB)
- 11 10-Drum Overpack (TDOP)
- 12 RH-TRU Waste Canister
- 13 DATA-H-1.2 Dunnage Containers
- 14 **Dunnage containers are empty containers used to complete a shipping configuration, such as**
- 15 the seven-pack, if too few containers are available that meet transportation requirements.
- 16 Dunnage containers must clearly be marked "Empty." The TDOP and the RH-TRU Waste
- 17 Canister are not used as dunnage containers for shipping purposes. For emplacement
- 18 purposes in the repository, the 208-, 322-, and 379-L (55-, 85-, and 100-g) drums can be used
- 19 as dunnage containers and only if they arrive in a shrink-wrapped package assembly such as
- 20 the seven-pack, four-pack, or three-pack. To date, only 208-L (55-g) drums have been
- 21 *emplaced in the repository as dunnage containers.*

- 1 The 208-L (55-g) drum is shipped in a seven-pack configuration and is normally emplaced in
- 2 the repository in the same configuration, but can be emplaced as an individual unit should the
- 3 need arise. A single drum can be used for collecting and storing site-derived waste. An
- 4 illustration of the 55-gallon drum components and emplacement configuration are provided in
- 5 Figure DATA-H-1. The drum's specifications are provided in Table DATA-H-1.

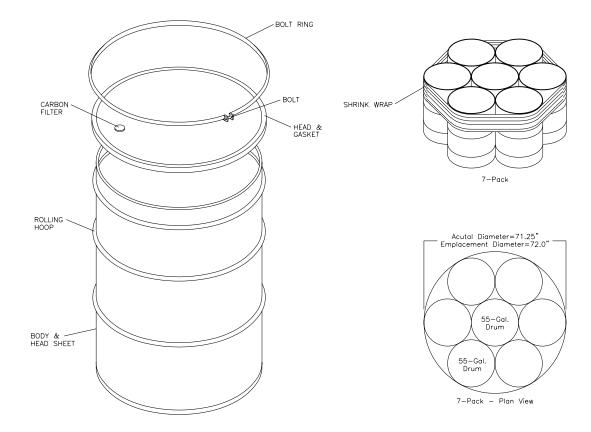


Figure DATA-H-1. 55-Gallon Drum Components and Emplacement Configuration.

8

### Table DATA-H-1. 55-Gallon Drum Specifications

		Approximate Measurement				
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	<b>O.D.</b> (mm)	Approximate	e Volume
Height	<i>32 <sup>5</sup>/</i> 8	<i>34 ¼</i>	830	870	Gallons 55	
Diameter	22 1/2	23 <sup>3</sup> / <sub>4</sub>	572	603	Liters	208
					Cubic Feet	7.35
					Cubic Meters	0.208

- 1 The 322-L (85-g) drum is shipped in a four-pack configuration and will be emplaced in the
- 2 repository in the same configuration but can be emplaced as an individual unit should the
- 3 need arise. A single drum can be used for collecting and storing site-derived waste. An
- 4 illustration of the 85-gallon drum (short) components and emplacement configuration are
- 5 provided in Figure DATA-H-2. The drum's specifications are provided in Table DATA-H-2.

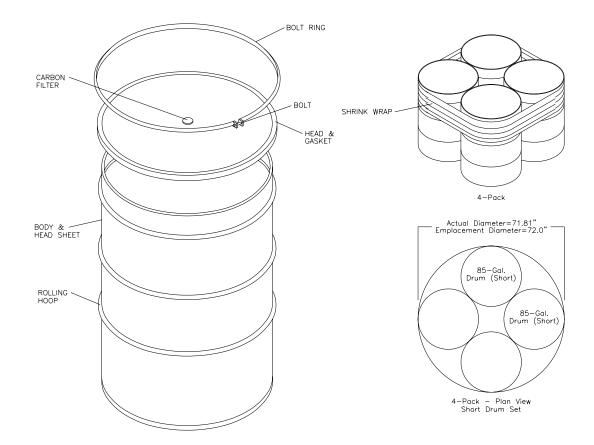



Figure DATA-H-2. 85-Gallon Drum (Short) Components and Emplacement Configuration.

8

Table DATA-H-2. 85-Gallon Drum (Short) Specifications

		Approximate					
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	<b>O.D.</b> (mm)	Approximate	imate Volume	
Height	33 ¼	35	845	889	Gallons 85		
Diameter	27 1/8	<b>29</b> <sup>3</sup> / <sub>4</sub>	689	756	Liters	322	
					Cubic Feet	11.3	
					Cubic Meters	0.32	

- 1 The 322-L (85-g) drum is shipped in a four-pack configuration and will be emplaced in the
- 2 repository in the same configuration. It is also used for overpacking 208-L (55-g) drums that
- 3 are individually emplaced in the repository. A single drum can be used for collecting and
- 4 storing site-derived waste. An illustration of the 85-gallon drum (tall) components and
- 5 *emplacement configuration are provided in Figure DATA-H-3. The drum's specifications are*
- 6 provided in Table DATA-H-3.

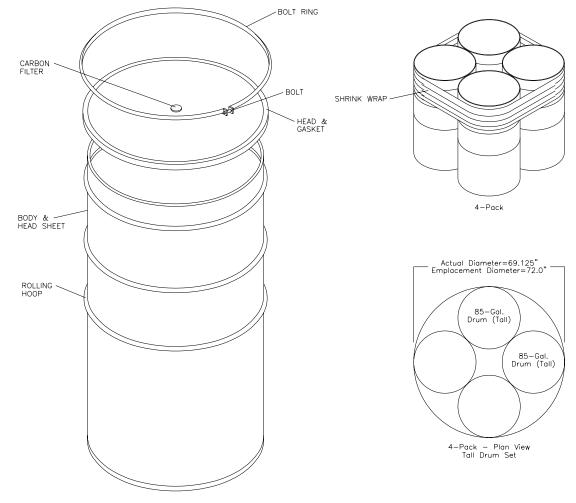

8 Figure DATA-H-3. 85-Gallon Drum (Tall) Components and Emplacement Configuration.

9

7

Table DATA-H-3. 85-Gallon Drum (Tall) Specifications

		Approximate				
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	0.D. (mm)	Approximate Volume	
Height	<u>38 ¼</u>	<b>40</b> ¼	<b>9</b> 72	1,022	Gallons	85
Diameter	26	<b>28</b> 5/8	660	728	Liters	322
					Cubic Feet	11.3
					Cubic Meters	0.32

- 1 The 379-L (100-g) drum is shipped in a three-pack configuration and will be emplaced in the
- 2 repository in the same configuration. The 379-L (100-g) drum can be emplaced as an
- 3 individual unit should the need arise. An illustration of the 100-gallon drum components and
- 4 *emplacement configuration are provided in Figure DATA-H-4. The drum's specifications are*
- 5 provided in Table DATA-H-4.

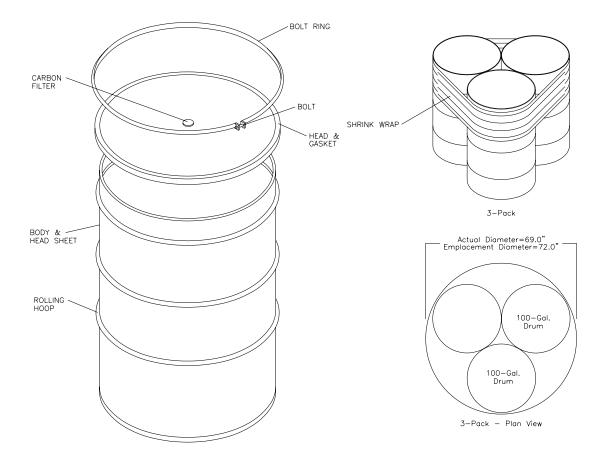



Figure DATA-H-4. 100-Gallon Drum Components and Emplacement Configuration.

8

### Table DATA-H-4. 100-Gallon Drum Specifications

		Approximate	Measuremen				
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	<b>O.D.</b> (mm)	Approximate Volume		
Height	33	35	838	889	Gallons	100	
Diameter	30	32	762	813	Liters	379	
					Cubic Feet	13.4	
					Cubic Meters	0.38	

The SWB is shipped and emplaced as an individual unit. Normally, two SWBs are shipped in 1 a TRUPACT-II shipping container. An illustration of the SWB is provided in Figure DATA-2 3 H-5. The box's specifications are provided in Table DATA-H-5.

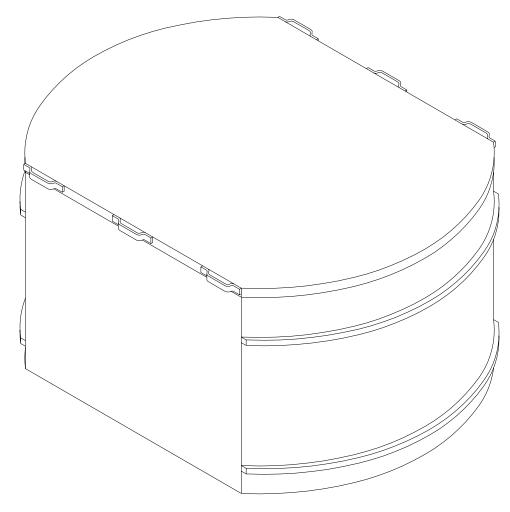






6

Figure DATA-H-5. Illustration of a Standard Waste Box.

### Table DATA-H-5. SWB Specifications

		Approximate Measurement					
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	<b>O.D.</b> (mm)	Approximate Volume		
Height	<b>36</b> ¾	37	<i>933</i>	<i>940</i>	Gallons	<b>496</b>	
Length	<b>68</b> <sup>3</sup> / <sub>4</sub>	71	1,746	1,803	Liters	<b>1,8</b> 77	
Width	51 7/8	54	1,318	1,372	Cubic Feet	66.3	
					Cubic Meters	1.88	

- 1 The TDOP is shipped as an individual unit and emplaced as an individual unit. An
- 2 illustration of the TDOP's components is provided in Figure DATA-H-6. The overpack's
  3 specifications are provided in Table DATA-H-6.

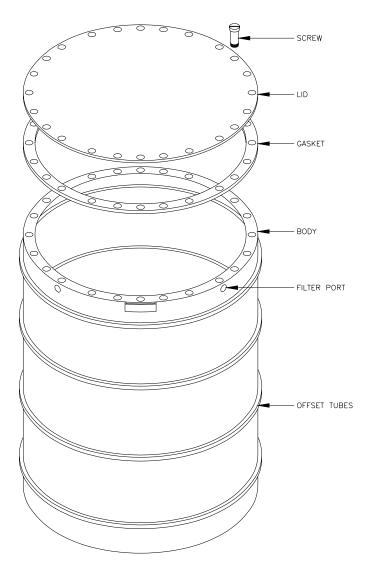



# Figure DATA-H-6. TDOP Components.

# Table DATA-H-6. TDOP Specifications

		Approximate				
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	<b>O.D.</b> (mm)	Approximate Volume	
Height	70 ½	73	<i>1791</i>	1,854	Gallons	<i>1,197</i>
Diameter	71 ½	72	1,816	1,829	Liters	4,531
					Cubic Feet	160
					Cubic Meters	4.5

7 8

DOE/WIPP 2004-3231

- 1 The RH-TRU Waste Canister is shipped as a single unit and emplaced as a single unit.
- 2 Illustrations of the canister's components are provided in Figure DATA-H-7. The canister's 3 specifications are provided in Table DATA-H-7.

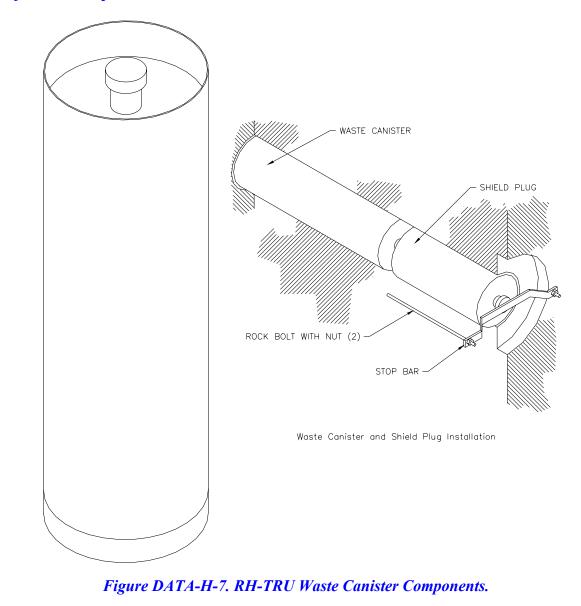


Table DATA-H-7. RH-TRU Waste Canister Specifications

		Approximate					
Dimension	I.D. (inches)	O.D. (inches)	I.D. (mm)	<b>O.D.</b> (mm)	Approximate Volume		
Height	108	121	2,743	3,073	Gallons	235	
Diameter	25 ½	26	<u>648</u>	660	Liters	<b>890</b>	
					Cubic Feet	31.44	
					Cubic Meters	0.89	

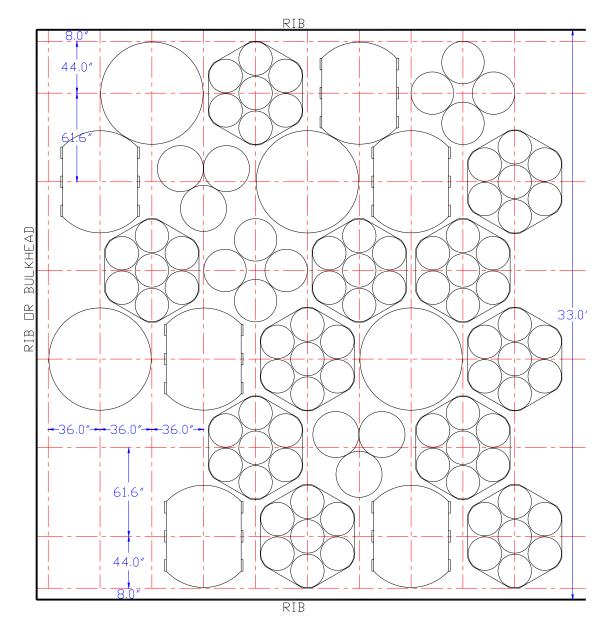




Figure DATA-H-8. CH-TRU Waste Emplacement Layout.

3 Shown above in Figure DATA-H-8 is the typical position for waste emplacement containers in

4 *a room of a panel. TDOPs are only emplaced on the bottom position with another assembly* 

5 stacked on top. All of the other assemblies can be stacked three high before the MgO

6 supersack is emplaced on the top of the stack. CH-TRU waste emplacement within the

7 repository panels is shown in Figure DATA-H-9. The planned RH-TRU waste emplacement

8 is shown in Figure DATA-H-10.




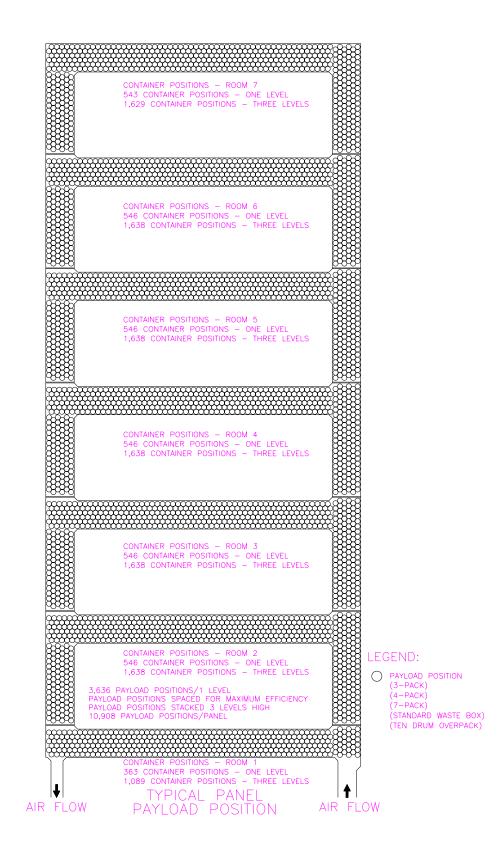


Figure DATA-H-9. CH-TRU Waste Emplacement.

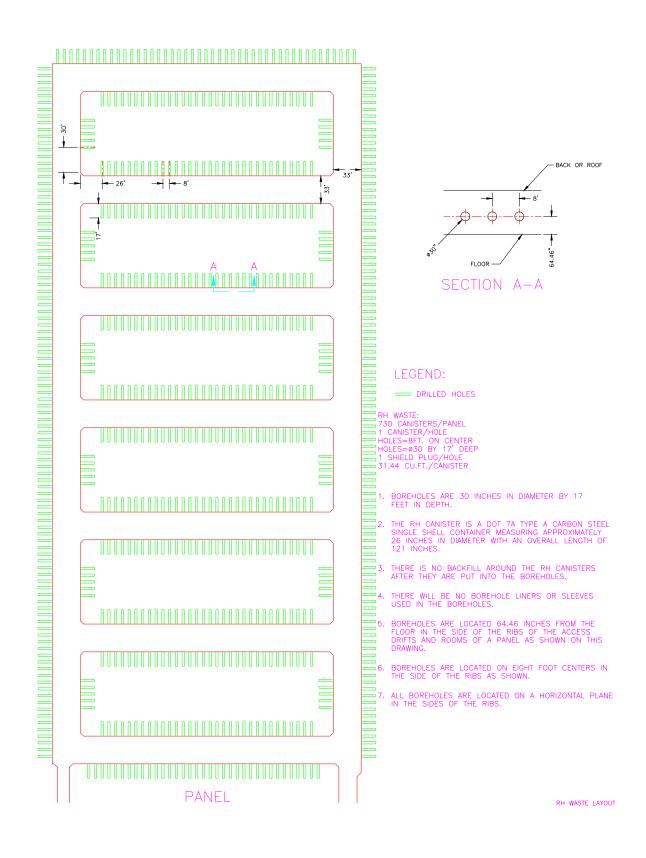

3

### Figure DATA-H-10. Planned RH-TRU Waste Emplacement.

DOE/WIPP 2004-3231

This page intentionally left blank